SO #2
Well #3

475809122214102

29N/03E-25K

WELL LOG

63F

(Clinton Water District #13900C)

Well Walley Drilled 11-71
Pump Installed 4-24-72
New Pump Motor Installed 11-80
Well #2

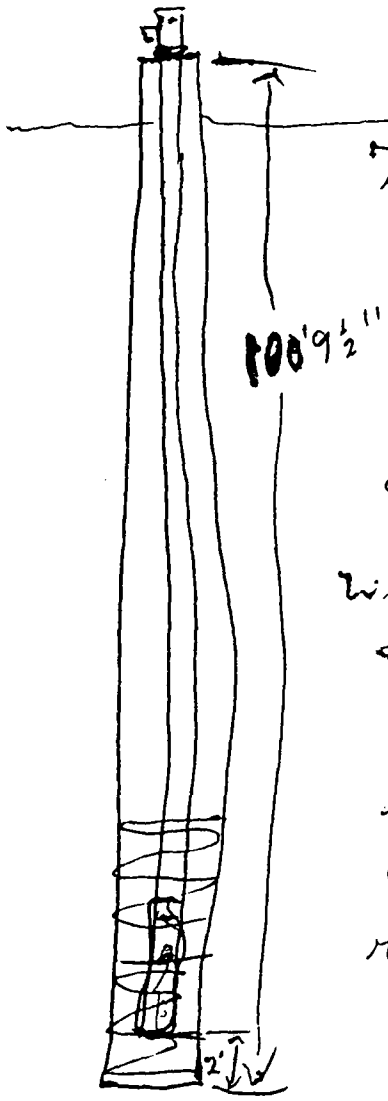

7½ H - 240v - 3 phase pump
3" gal pipe -
Pump 2' from Bottom
pumped 120 G.P.M for 15 hr.
drew down to 65'

With Both Pumps off all night
static level was 32' 10"

2-9-77 - 35' fan tops
8-11-77 - Hot - Both
running several days - 83' down

9/5/97
4